




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Mount Design		
<b>Object:</b>	HILO Flexwall		
<b>Size [mm]:</b>	w = 1420	h = 1190	d = 1670

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	1.3
125	1.8
250	2.4
500	3.3
1000	4.9
2000	6.4
4000	7.9
<b>N<sub>10</sub> = 3</b>	

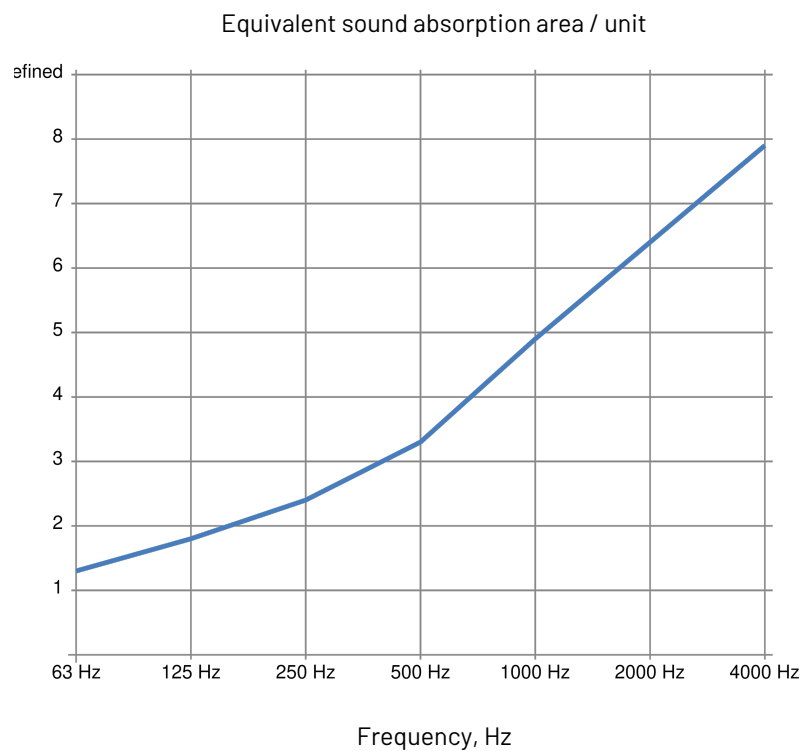

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 20-720-M4	2020-06-23

