




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Mount Design		
Object:	HILO Flexwall		
Size [mm]:	w = 1620	h = 1190	d = 1670

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	1.3
125	1.9
250	2.5
500	3.6
1000	5.3
2000	6.9
4000	8.5
N₁₀ = 2.8	

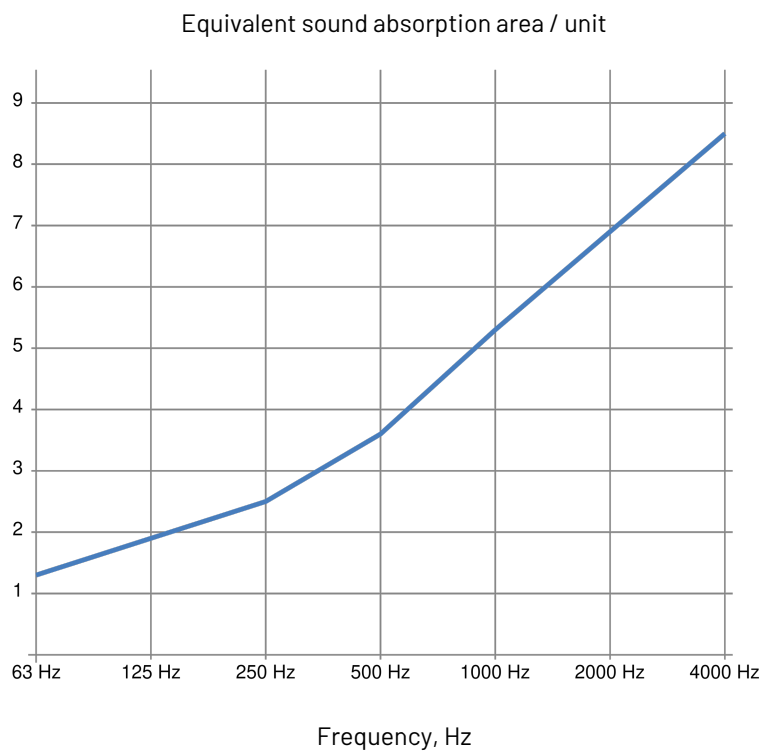

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 20-720-M5	2020-06-23

