




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Mount Design		
<b>Object:</b>	HILO Flexwall		
<b>Size [mm]:</b>	w = 1620	h = 1190	d = 1670

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	1.3
125	1.9
250	2.5
500	3.6
1000	5.3
2000	6.9
4000	8.5
<b>N<sub>10</sub> = 2.8</b>	

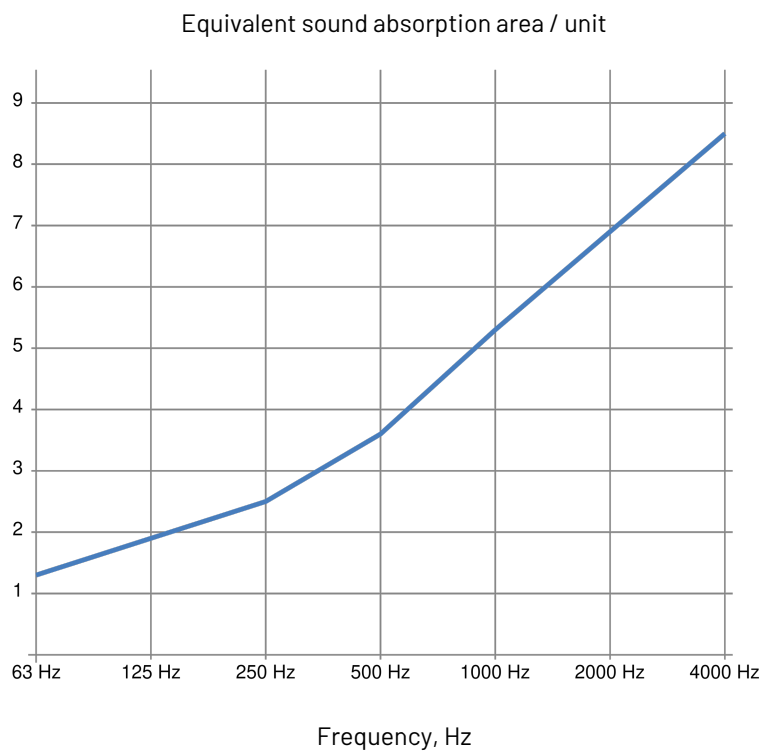

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 20-720-M5	2020-06-23

