




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Mount Design		
Object:	HILO Flexwall		
Size [mm]:	w = 1820	h = 1190	d = 1670

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	1.3
125	2
250	2.6
500	3.8
1000	5.6
2000	7.3
4000	9
N₁₀ = 2.6	

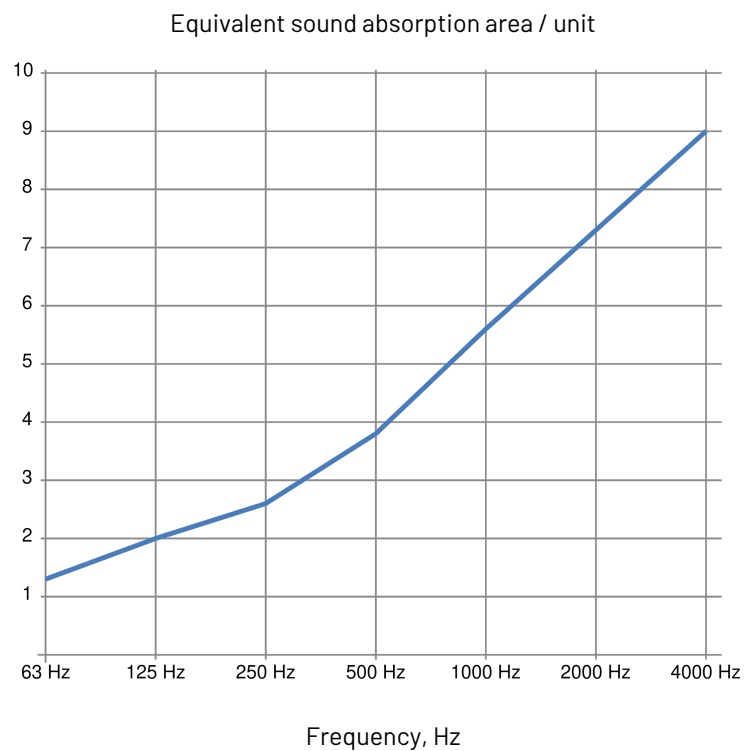

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 20-720-M2	2020-06-23

