




SOUND ABSORPTION COEFFICIENT

Measured and evaluated according to ISO 354 and ISO 11654

Client:	Rom & Tonik
Surface:	Basic Wall 58x58
Suspension Height:	w = 400

Octave band (Hz)	Sound absorption coefficient (-)
63	0.15
125	0.35
250	0.8
500	0.9
1000	1
2000	1
4000	1
α_w	1.00
NRC	0.95

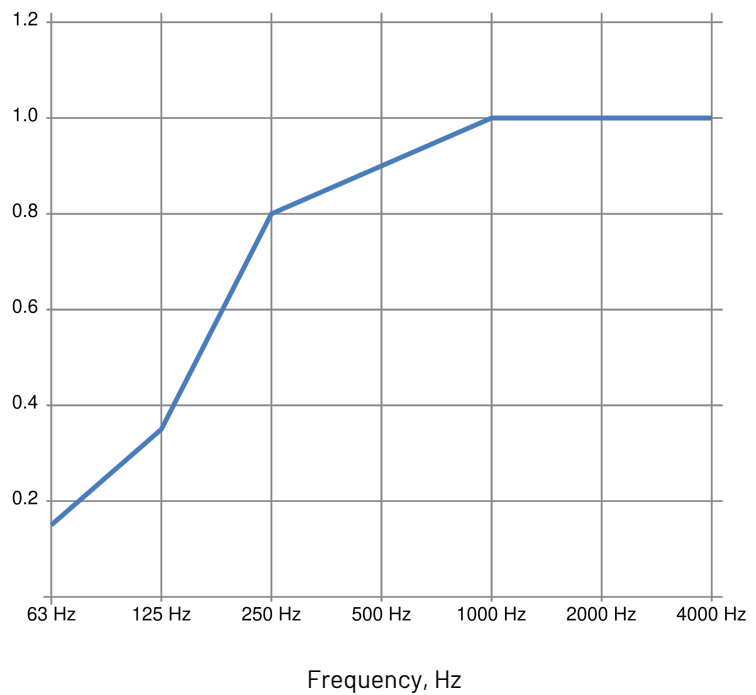

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-701-M6	2021-03-15

