




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Rom & Tonik		
Object:	Felt Screen Floor 160		
Size [mm]:	w = 1600	h = 1000	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.47
125	0.76
250	1.2
500	1.6
1000	2.1
2000	2.3
4000	2.5
N₁₀ = 6.3	

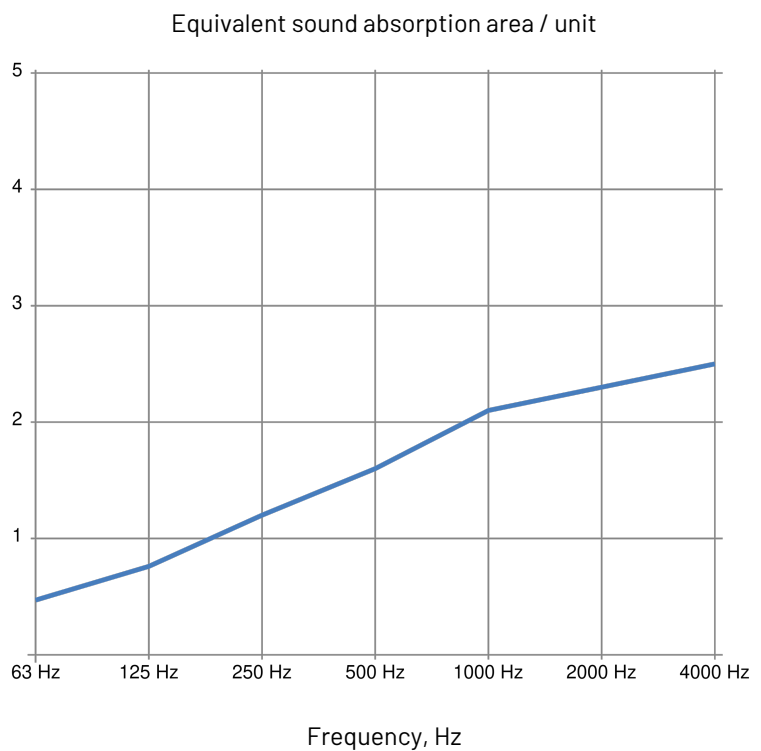

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-701-M19	2021-03-15

