




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp wall square 60/80		
Size [mm]:	w = 800	h = 800	d = 57

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.04
125	0.16
250	0.54
500	0.87
1000	0.85
2000	0.83
4000	0.73
N₁₀ = 13.7	

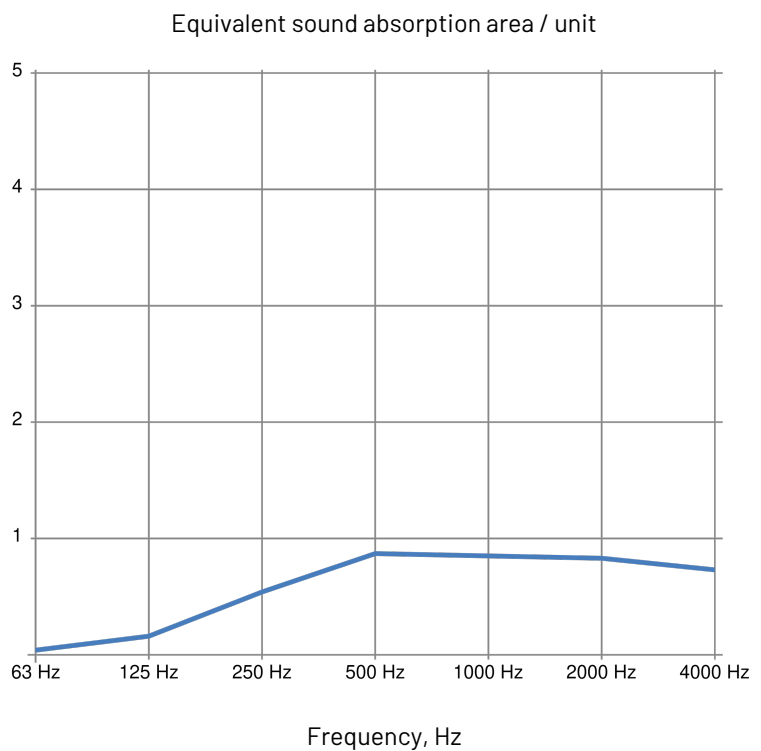

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M16	2021-10-29

