




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption		
<b>Size [mm]:</b>	w = 800	h = 1000	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.25
125	0.35
250	0.56
500	0.7
1000	0.81
2000	1
4000	1.24
<b>N<sub>10</sub> = 14.3</b>	

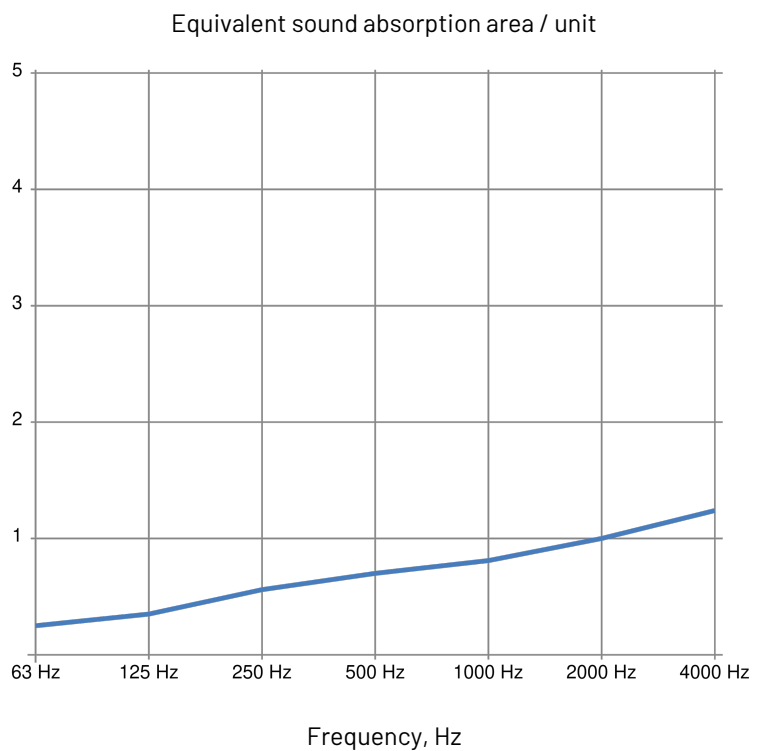

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 20-240-M2	2020-06-24
Akustikverkstan report 18-701-M3	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

