




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Boom Interior		
<b>Object:</b>	Xrozz Absorption Reinforced		
<b>Size [mm]:</b>	w = 600	h = 1400	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.27
125	0.36
250	0.59
500	0.75
1000	0.86
2000	1.06
4000	1.3
<b>N<sub>10</sub> = 13.3</b>	

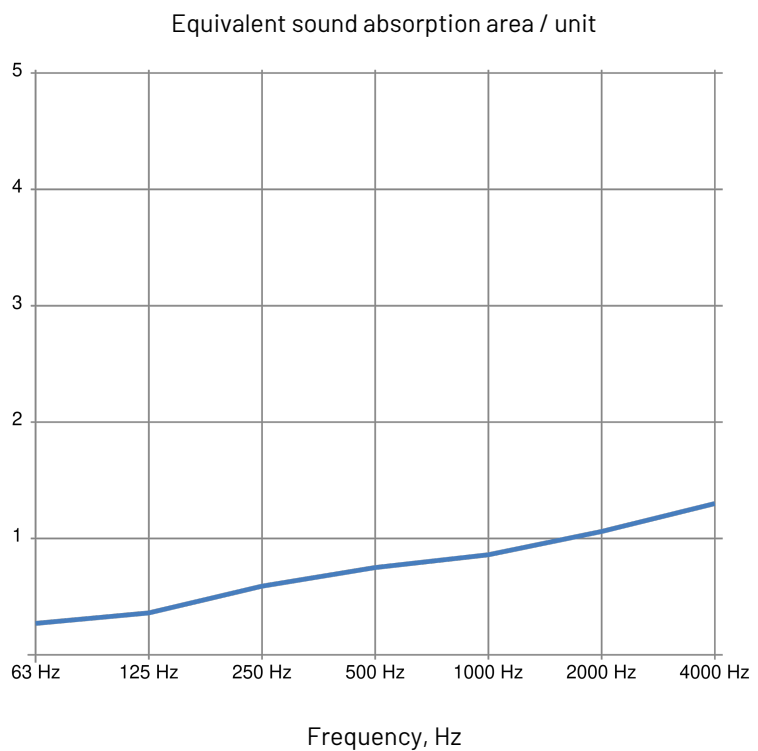

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M15a	2018-08-23
Akustikverkstan report 18-701-M16	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

