




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Boom Interior		
Object:	Xrozz Absorption Reinforced		
Size [mm]:	w = 800	h = 1000	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.25
125	0.35
250	0.56
500	0.7
1000	0.81
2000	1
4000	1.24
N₁₀ = 14.3	

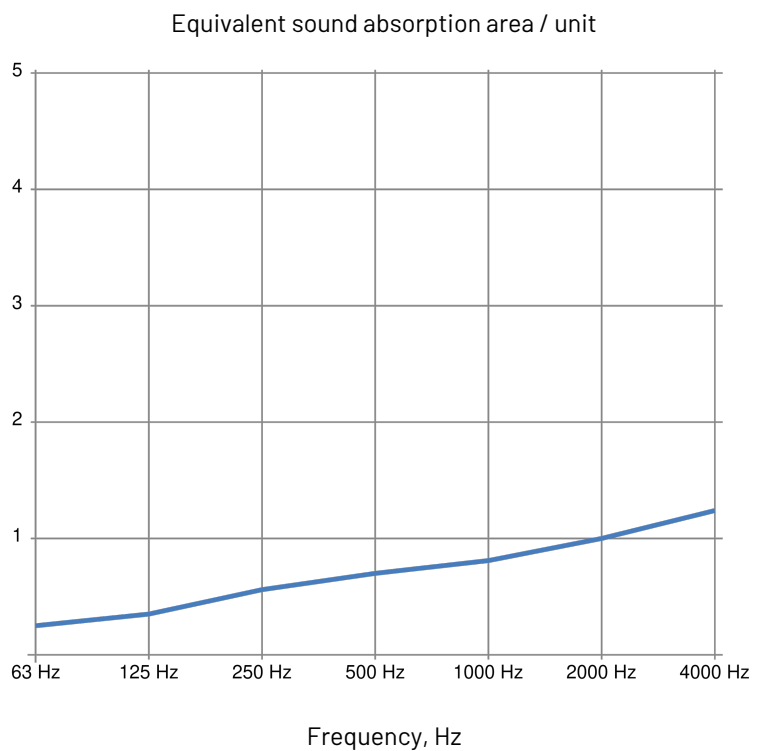

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M15a	2018-08-23
Akustikverkstan report 18-701-M16	2018-08-23

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

