




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Holly lighting, vertical		
<b>Size [mm]:</b>	w = 883	h = 585	d = 540

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0
125	0.18
250	0.54
500	0.91
1000	0.72
2000	0.81
4000	0.84
<b>N<sub>10</sub> = 13.9</b>	

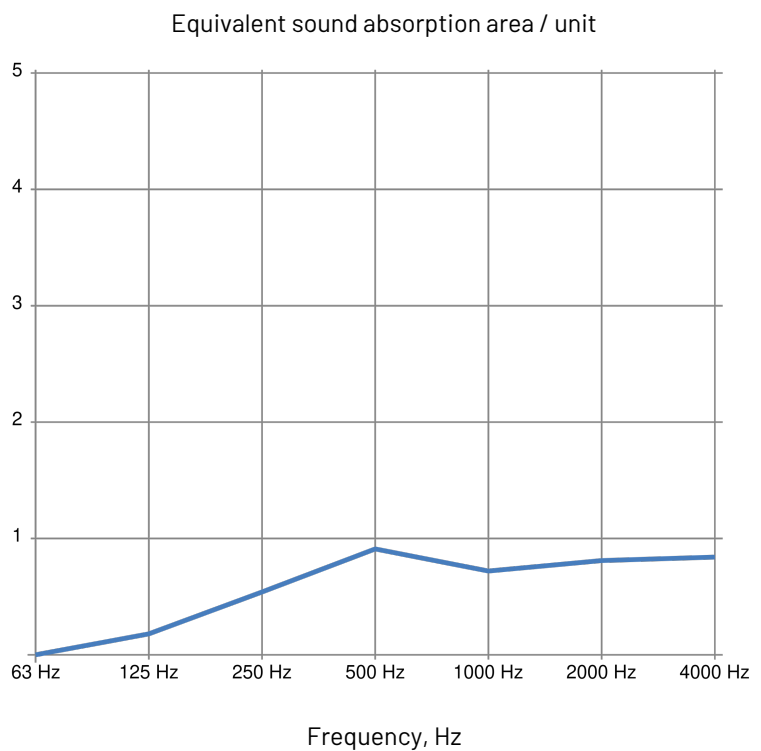

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
20220608.1	2023-04-20

