




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Glimakra Of Sweden		
Object:	Contrast Floor Screen		
Size [mm]:	w = 1200	h = 1500	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0
125	0.2
250	0.6
500	1.4
1000	2.6
2000	3.1
4000	2.8
N₁₀ = 7.1	

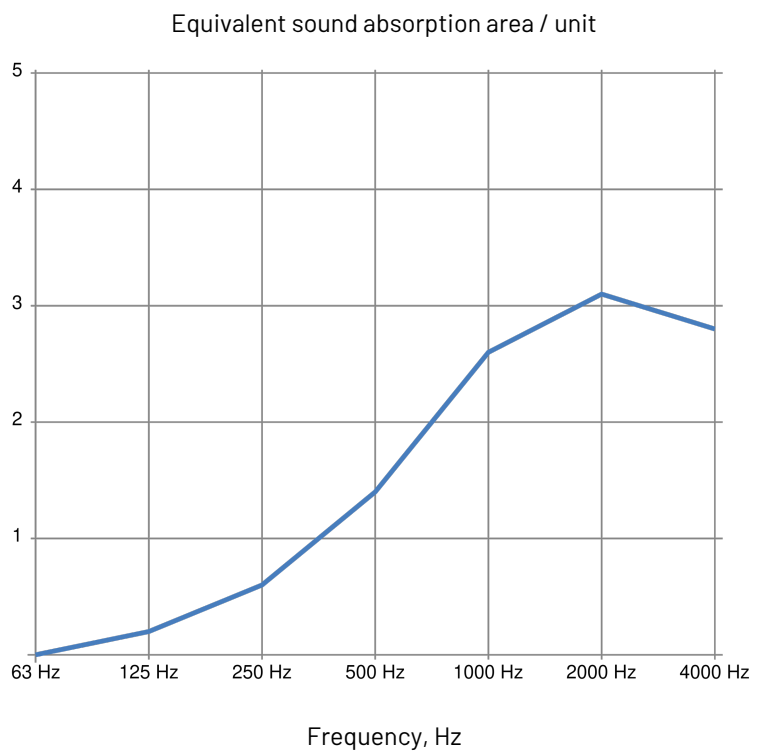

ORIGINAL TEST REPORT	DATE OF TEST
WSP Acoustics report 10171560.03	2012-01-30

