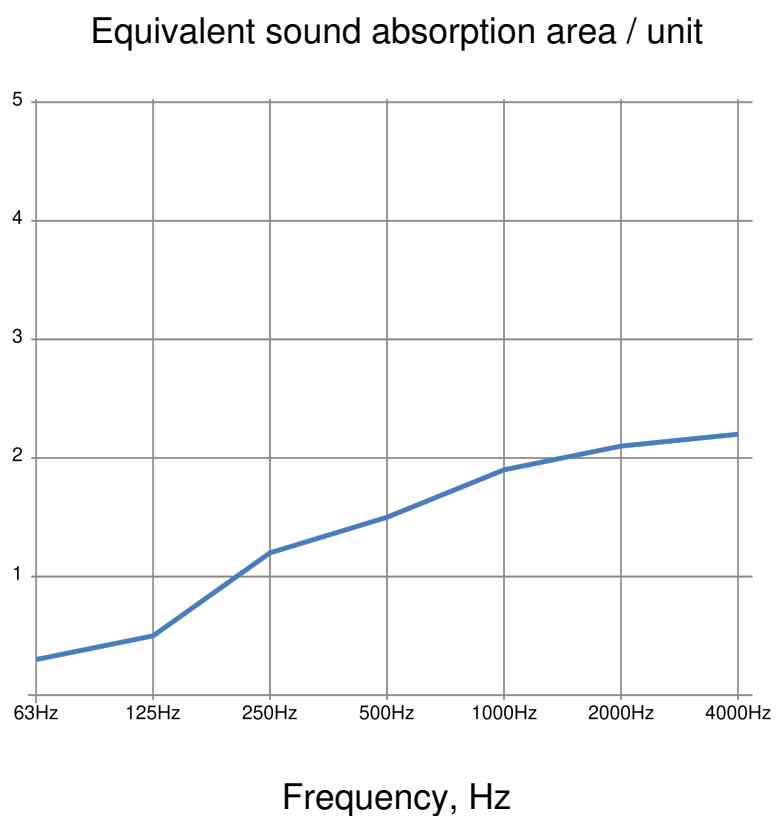


SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to SS-EN ISO 354 and ISO 20189

| | | | |
|------------|----------------------|---------|--------|
| Client: | Götessons/ Gotessons | | |
| Object: | ScreenIT A30 | | |
| Size [mm]: | w = 1800 | h = 800 | d = 40 |

| 1/3 octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|----------------------|---|
| 63 | 0.3 |
| 125 | 0.5 |
| 250 | 1.2 |
| 500 | 1.5 |
| 1000 | 1.9 |
| 2000 | 2.1 |
| 4000 | 2.2 |
| N ₁₀ = 7 | |

**CONDITIONS**

| | | | |
|---------------|------------|-------------------|---------------------|
| Date of test: | 2017-04-28 | Object volume: | 0.06 m ³ |
| Date: | 2020-02-21 | Rev. room volume: | 200 m ³ |

Test report: Akustikverkstan report 17-091-M2
 Signature: Carl Nyqvist