


SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to SS-EN ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Chesterfield 6 pcs		
Size [mm]:	w = 600	h = 600	d = 40

1/3 octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0
125	0.1
250	0.3
500	0.6
1000	0.6
2000	0.5
4000	0.3
N ₁₀ = 33	

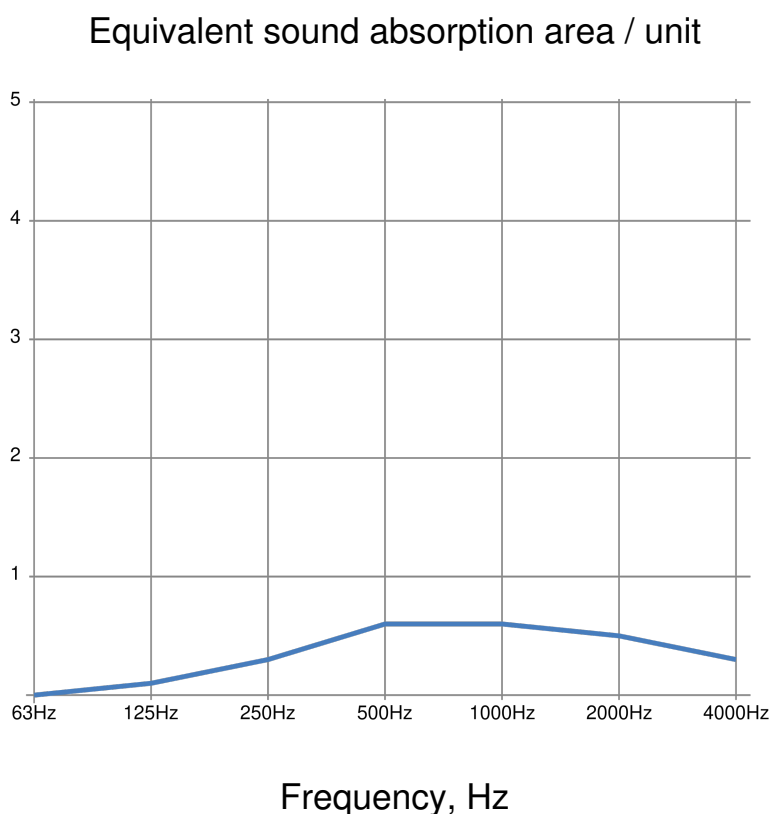

CONDITIONS

Date of test:	2018-03-20	Object volume:	0.01 m ³
Date:	2018-03-20	Rev. room volume:	200 m ³

Test report: Akustikversktan 18-051-M5
 Signature: Anders Grimmehed