




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|-------------|----------|--------|
| Client: | Decibel AB | | |
| Object: | Hertz 6 pcs | | |
| Size [mm]: | w = 1800 | h = 1200 | d = 60 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0.1 |
| 125 | 1 |
| 250 | 2.2 |
| 500 | 2.8 |
| 1000 | 2.9 |
| 2000 | 2.6 |
| 4000 | 2.4 |
| N₁₀ = 4.2 | |

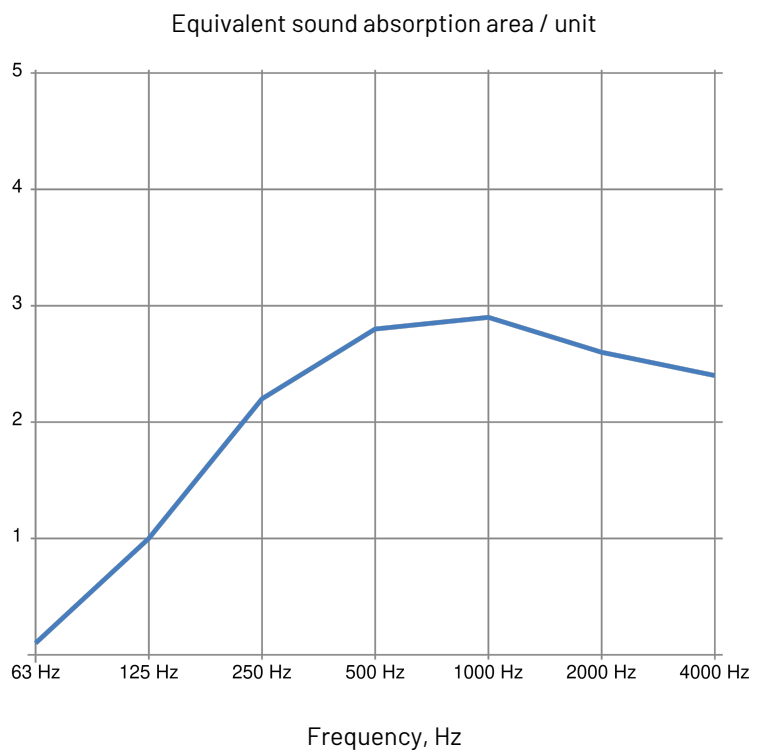

| | |
|-----------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverskan 18-051-M13 | 2018-10-22 |

