




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Bits Wall		
<b>Size [mm]:</b>	w = 510	h = 580	d = 95

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0
125	0.04
250	0.09
500	0.13
1000	0.14
2000	0.14
4000	0.13
<b>N<sub>10</sub> = 76.9</b>	

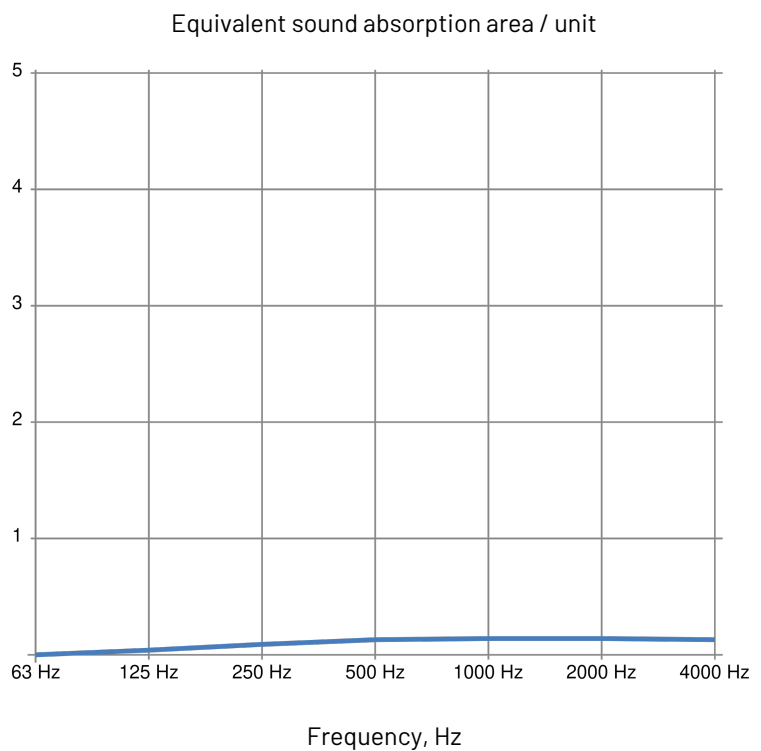

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
SG-Bauakustik report SG 1370-001-12	2012-02-16

