




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Scala Wall		
Size [mm]:	w = 1207	h = 1600	d = 20

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0
125	0.21
250	0.77
500	1.94
1000	2.29
2000	1.91
4000	2.19
N₁₀ = 5.2	

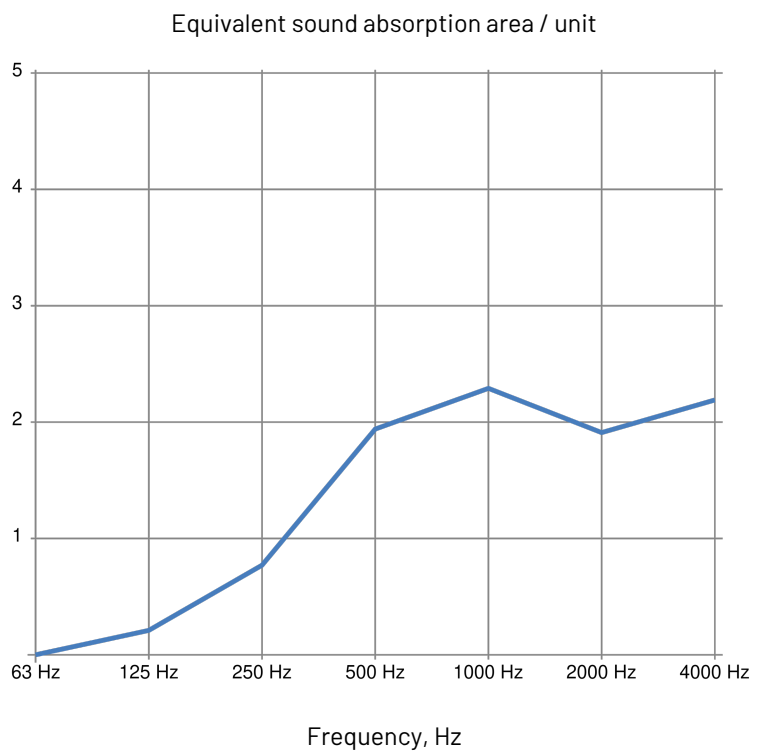

ORIGINAL TEST REPORT	DATE OF REPORT
KTH-MWL LW20170314_R2	2017-03-14

