




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Softline 50 Floor Screen		
<b>Size [mm]:</b>	w = 800	h = 1360	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.2
125	0.3
250	0.9
500	1.5
1000	1.8
2000	1.8
4000	1.9
<b>N<sub>10</sub> = 6.7</b>	

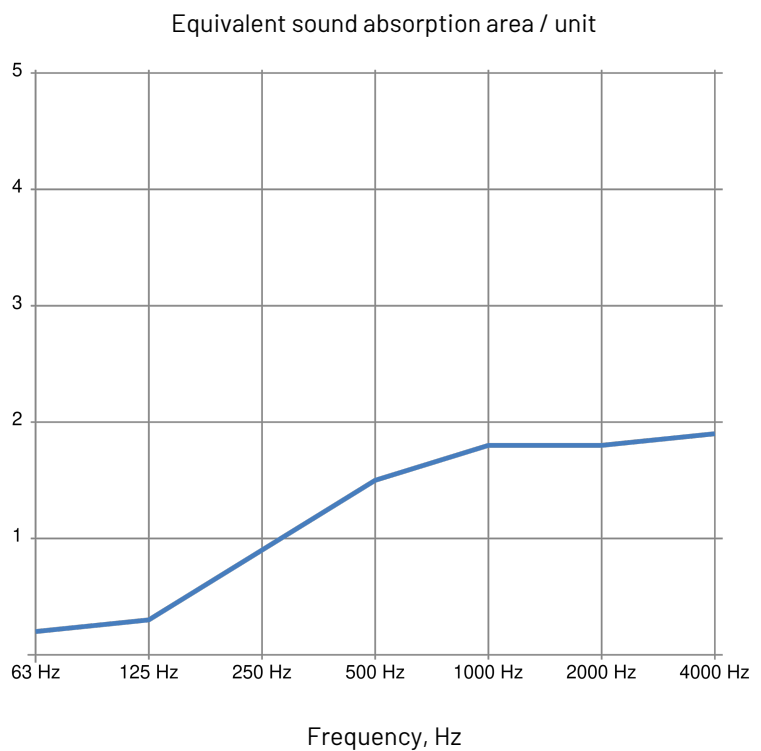

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 18-720-R2-M13	2018-12-13

