




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Softline 50 Floor Screen		
Size [mm]:	w = 1000	h = 1700	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.4
125	0.5
250	1.4
500	2.3
1000	2.8
2000	2.9
4000	2.9
N₁₀ = 4.3	

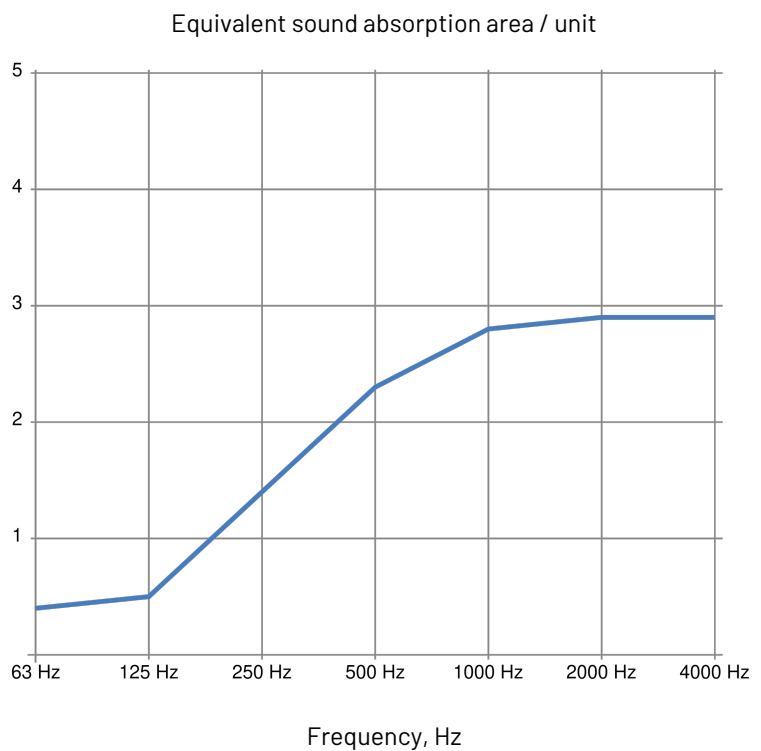

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 18-720-R2-M20	2018-12-13

