




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|----------------------|----------|----------|
| Client: | Götessons/ Gotessons | | |
| Object: | ScreenIT A30 Booth | | |
| Size [mm]: | w = 2840 | h = 1400 | d = 1800 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 2.63 |
| 125 | 4.93 |
| 250 | 8.13 |
| 500 | 10.87 |
| 1000 | 12.1 |
| 2000 | 13.3 |
| 4000 | 13.8 |
| N₁₀ = 1.0 | |

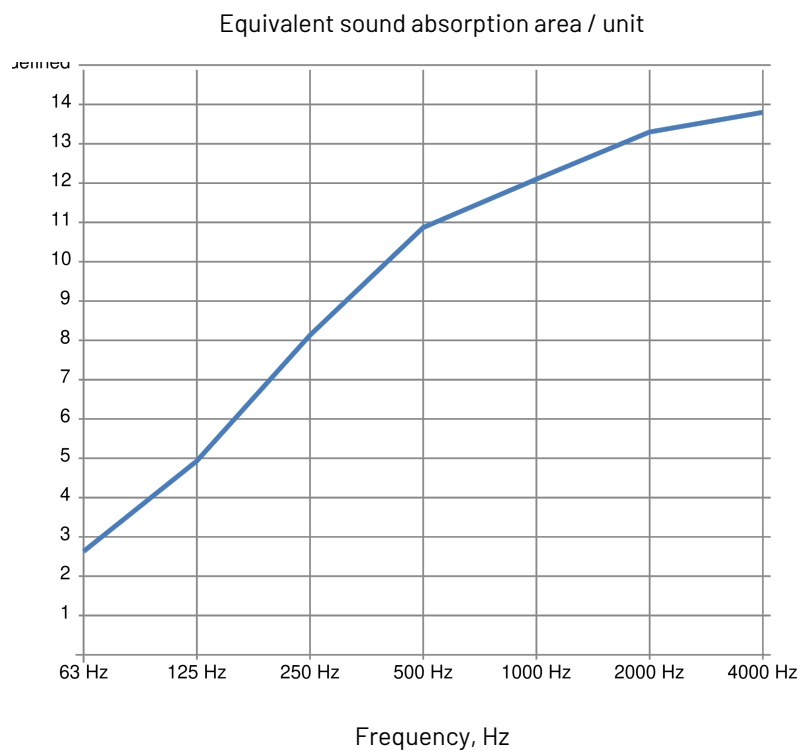

| | |
|-----------------------------|---------------------|
| ORIGINAL TEST REPORT | DATE OF TEST |
| SP report 4P03825 C | 2014-06-02 |

